


EDIBON PATENT



Always included in the supply:

SCADA. EDIBON Computer Control System



② Control Interface Box



③ Data Acquisition Board



④ Software for:
- Computer Control
- Data Acquisition
- Data Management

⑤ Cables and Accessories
⑥ Manuals

Teaching Technique used




Computer (not included in the supply)

OPEN CONTROL
+
MULTICONTROL
+
REAL TIME CONTROL

① Unit: CAPC. Wetted Wall Gas Absorption Column

Unitary Process Configuration

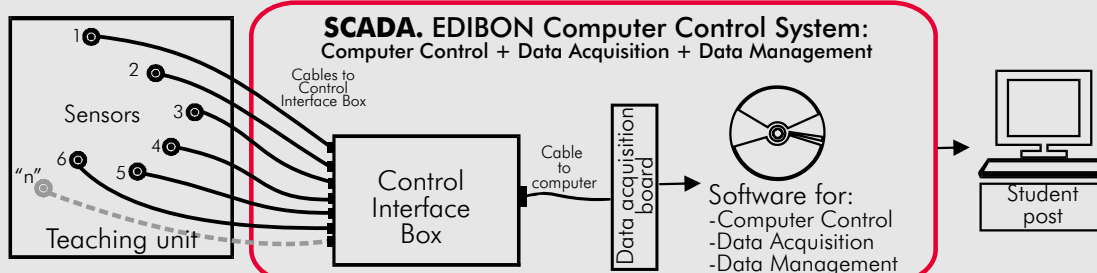

www.edibon.com

Products
Products range
Units
11.-Chemical Engineering



ISO 9001:2000
Certificate of Approval



European Union Certificate



Certificates ISO 14001: 2004 and
ECO-Management and Audit Scheme
(environmental management)



Worlddidac Quality Charter
Certificate
Worlddidac Member

DESCRIPTION

Floor standing unit used for demonstration and determination of liquid film mass transfer coefficients.

This unit examines absorption of oxygen from air into deoxygenated water.

The specific demonstrations include:

- Calculation of liquid film mass transfer coefficient.
- Variation of this coefficient with mass flow rate.
- Determination of the power law relationship.

This Computer Controlled Unit is supplied with the EDIBON Computer Control System (SCADA), including: Control interface Box + Data Acquisition Board + Computer Control and Data Acquisition Software, for controlling the process and the parameters involved.

SPECIFICATIONS

Items supplied as standard

① CAPC. Unit:

Anodized aluminium structure and panels in painted steel.

Main metallic elements in stainless steel.

Diagram in the front panel with similar distribution to the elements in the real unit.

Wetted wall column of glass, with water inlet and outlet sections. Height: 900 mm, internal diameter: 32 mm.

Feed pump of the absorption column.

Air flow sensor.

Water flow sensor.

Deoxygenating column of transparent acrylic material. Height: 1570 mm, internal diameter: 25 mm.

Deoxygenator feed pump.

Oxygen meter and oxygen analysis probes (saturation, concentration, temperature).

Air feed pump.

Water tank, capacity 50 l. approx.

Pumps control from computer.

The unit incorporates wheels for mobility.

② CAPC/CIB. Control Interface Box :

Control interface box with process diagram in the front panel and with the same distribution that the different elements located in the unit, for an easy understanding by the student.

All sensors, with their respective signals, are properly manipulated from -10V. to +10V computer output. Sensors connectors in the interface have different pins numbers (from 2 to 16), to avoid connection errors. Single cable between the control interface box and computer.

The unit control elements are permanently computer controlled, without necessity of changes or connections during the whole process test procedure. Simultaneously visualization in the computer of all parameters involved in the process.

Calibration of all sensors involved in the process.

Real time curves representation about system responses. Storage of all the process data and results in a file. Graphic representation, in real time, of all the process/system responses.

All the actuators' values can be changed at any time from the keyboard allowing the analysis about curves and responses of the whole process. All the actuators and sensors values and their responses are placed in only one computer screen.

Shield and filtered signals to avoid external interferences.

Real time PID control with flexibility of modifications from the computer keyboard of the PID parameters, at any moment during the process. Real time PID and on/off control for pumps, compressors, resistances, control valves, etc. Real time PID control for parameters involved in the process simultaneously.

Open control allowing modifications, at any time and in a real time, of parameters involved in the process simultaneously.

Proportional control, integral control and derivative control, based on the real PID mathematical formula, by changing the values, at any time, of the three control constants (proportional, integral and derivative constants).

Possibility of automatization of the actuators involved in the process.

Three safety levels, one mechanical in the unit, other electronic in control interface and the third one in the control software.

③ DAB. Data Acquisition Board:

PCI Data acquisition board (National Instruments) to be placed in a computer slot. Bus PCI.

Analog input: Number of channels= 16 single-ended or 8 differential. Resolution= 16 bits, 1 in 65536.

Sampling rate up to: 250 KS/s (Kilo samples per second).

Input range (V) = $\pm 10V$. Data transfers=DMA, interrupts, programmed I/O. Number of DMA channels=6.

Analog output: Number of channels=2. Resolution= 16 bits, 1 in 65536. Maximum output rate up to: 833 KS/s.

Output range (V) = $\pm 10V$. Data transfers=DMA, interrupts, programmed I/O.

Digital Input/Output: Number of channels=24 inputs/outputs. D0 or DI Sample Clock frequency: 0 to 1 MHz.

Timing: Counter/timers=2. Resolution: Counter/timers: 32 bits.

④ CAPC/CCSOF. Computer Control+ Data Acquisition+ Data Management Software:

Compatible with actual Windows operating systems. Graphic and intuitive simulation of the process in screen. Compatible with the industry standards.

Registration and visualization of all process variables in an automatic and simultaneously way.

Flexible, open and multicontrol software, developed with actual windows graphic systems, acting simultaneously on all process parameters.

Analog and digital PID control. Menu for PID and set point selection required in the whole work range.

Management, processing, comparison and storage of data. Sampling velocity up to 250,000 data per second guaranteed. Calibration system for the sensors involved in the process.

It allows the registration of the alarms state and the graphic representation in real time.

Comparative analysis of the obtained data, after the process and modification of the conditions during the process.

Open software, allowing to the teacher to modify texts, instructions. Teacher's and student's passwords to facilitate the teacher's control on the student, and allowing the access at different work levels.

This unit allows that the 30 students of the classroom can visualize simultaneously all results and manipulation of the unit, during the process, by using a projector.

⑤ Cables and Accessories, for normal operation.

⑥ Manuals:

This unit is supplied with 8 manuals: Required Services, Assembly and Installation, Interface and Control Software, Starting-up, Safety, Maintenance, Calibration & Practices Manuals.

*** References 1 to 6: CAPC + CAPC/CIB + DAB + CAPC/CCSOF + Cables and Accessories + Manuals are included in the minimum supply, enabling a normal operation.**




CAPC. Unit



CAPC/CIB



DAB



CAPC/CCSOF

Continue...

Complementary items to the standard supply

PLC. Industrial Control using PLC (7 and 8):

⑦ PLC-PI. PLC Module:

Circuit diagram in the front panel.

Front panel:

Digital inputs(X) and Digital outputs (Y) block:

16 Digital inputs, activated by switches and 16 LEDs for confirmation (red).

14 Digital outputs (through SCSi connector) with 14 LEDs for message (green).

Analog inputs block:

16 Analog inputs (-10V. to + 10V.) (through SCSi connector).

Analog outputs block:

4 Analog outputs (-10V. to + 10V.) (through SCSi connector).

Touch screen:

High visibility and multiple functions.

Display of a highly visible status.

Recipe function.

Bar graph function.

Flow display function.

Alarm list.

Multi language function.

True type fonts.

Back panel:

Power supply connector.

Fuse 2A.

RS-232 connector to PC.

Inside:

Power supply outputs: 24 Vdc, 12 Vdc, -12 Vdc, 12 Vdc variable.

Panasonic PLC:

High-speed scan of 0.32 μ sec. for a basic instruction.

Program capacity of 32 Ksteps, with a sufficient comment area.

Free input AC voltage(100 to 240 V AC).

DC input: 16 (24 V DC).

Relay output: 14 (250 VA AC/2 A).

High-speed counter.

Multi-point PID control.

Digital inputs/outputs and analog inputs/outputs Panasonic modules.

Communication RS232 wire, to computer (PC).

⑧ CAPC/PLC-SOF. PLC Control Software:

For this particular unit, always included with PLC supply.



PLC-PI

Items available on request

⑨ CAPC/CAL. Computer Aided Learning Software (Results Calculation and Analysis).


⑩ CAPC/FSS. Faults Simulation System.

Some Practical Possibilities of the Unit:

- 1.- Absorption process study.
 - 2.- Calculation of liquid film mass transfer coefficients.
 - 3.- Variation of coefficient with mass flow rate.
 - 4.- Variation of oxygen flow rate to determine power law relationship.
 - 5.- The system chosen for the experiment is the absorption of oxygen into free water. In this system the solubility and enthalpy of solution are small and by saturating the inlet air with water, humidification effects are eliminated. Thus it is possible to maintain reasonably the isothermal conditions throughout the column.
 - 6.- These experiments allow a power law relationship to be calculated.
 - 7.- Effect of water flow rate.
 - 8.- Effect of oxygen flow rate.
- Other possible practices:
- 9.- Sensors calibration.
- Practices to be done by PLC Module (PLC-PI)+PLC Control Software:
- 10.- Control of the CAPC unit process through the control interface box without computer.
 - 11.- Visualization of all the sensors values used in CAPC unit process.
 - 12.- Calibration of all sensors included in CAPC unit process.
 - 13.- Hand on of all the actuators involved in the CAPC unit process.
 - 14.- Realization of different experiments, in automatic way, without having in front the unit. (This experiment can be decided previously).

- 15.- Simulation of outside actions, in the cases do not exist hardware elements (Example: test of complementary tanks, complementary industrial environment to the process to be studied, etc).
- 16.- PLC hardware general use and manipulation.
- 17.- PLC process application for the CAPC unit.
- 18.- PLC structure.
- 19.- PLC inputs and outputs configuration.
- 20.- PLC configuration possibilities.
- 21.- PLC program languages.
- 22.- PLC different programming standard languages (literal structured, graphic, etc.).
- 23.- New configuration and development of new process.
- 24.- Hand on an established process.
- 25.- To visualize and see the results and to make comparisons with the CAPC unit process.
- 26.- Possibility of creating new process in relation with the CAPC unit.
- 27.- PLC Programming exercises.
- 28.- Own PLC applications in accordance with teacher and student requirements.

POSSIBILITIES OF OTHER AVAILABLE EXPANSIONS

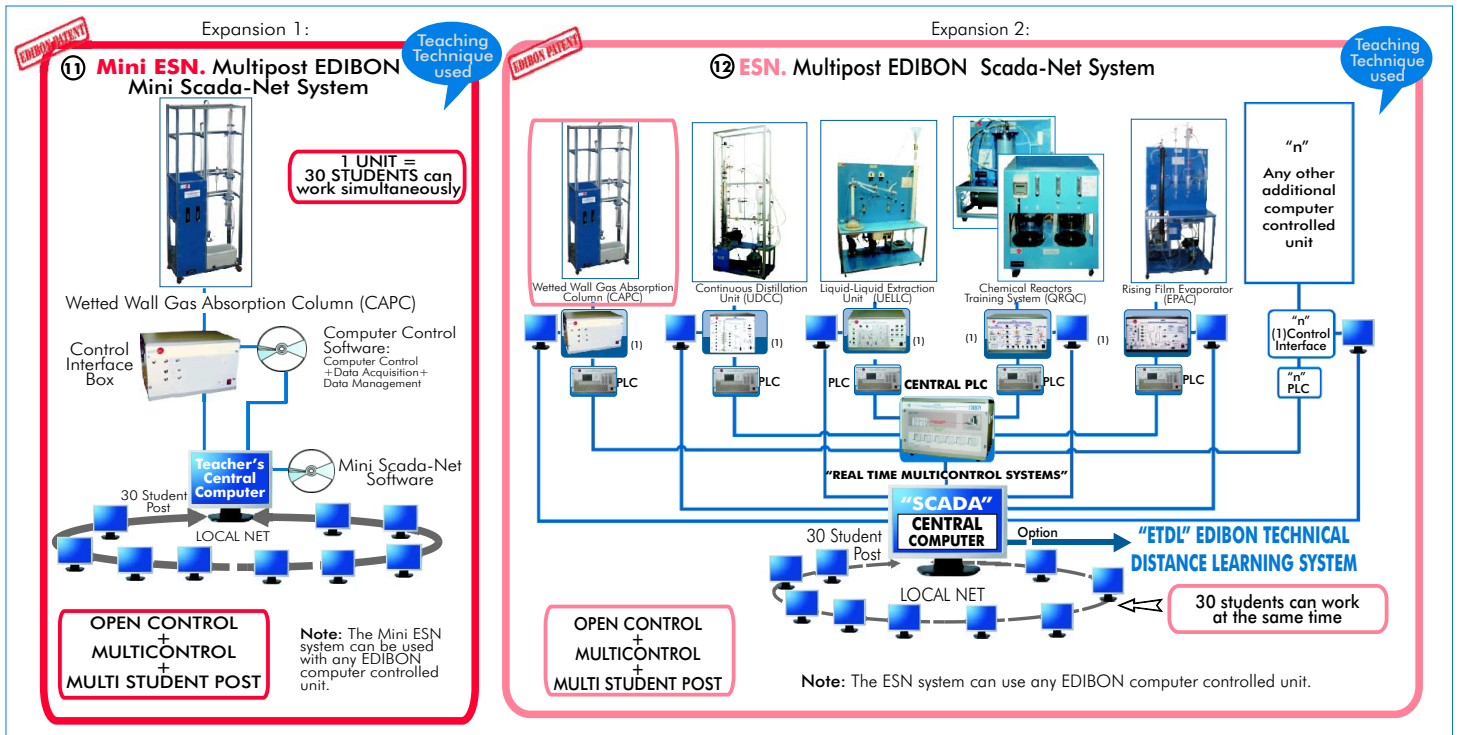

ORDER INFORMATION

Items supplied as standard

Minimum configuration for normal operation includes:

- ① Unit: CAPC. Wetted Wall Gas Absorption Column.
- ② CAPC/CIB. Control Interface Box.
- ③ DAB. Data Acquisition Board.
- ④ CAPC/CCSOF. Computer Control + Data Acquisition + Data Management Software.
- ⑤ Cables and Accessories, for normal operation.
- ⑥ Manuals.

* **IMPORTANT:** Under CAPC we always supply all the elements for immediate running as 1, 2, 3, 4, 5 and 6.

Complementary items to the standard supply

PLC. Industrial Control using PLC (7 and 8):

- ⑦ PCL-PI. PLC Module.
- ⑧ CAPC/PLC-SOF. PLC Control Software.
- ⑨ CAPC/CAL. Computer Aided Learning Software (Results Calculation and Analysis). (Available on request).
- ⑩ CAPC/FSS. Faults Simulation System. (Available on request).

Expansions

- ⑪ Mini ESN. Multipost EDIBON Mini Scada-Net System.
- ⑫ ESN. Multipost EDIBON Scada-Net System.

REQUIRED SERVICES

- Electrical supply: single-phase, 220V./50Hz or 110V./60Hz.
- Computer (PC).

ANCILLARY EQUIPMENT

- Cylinder of compressed nitrogen gas with pressure regulator. (Not supplied)

DIMENSIONS & WEIGHTS

CAPC Unit :	-Dimensions: 1000 x 500 x 2500 mm. approx. -Weight: 200 Kg. approx.
Control Interface Box:	-Dimensions: 490 x 330 x 310 mm. approx. -Weight: 10 Kg. approx.
PLC Module (PLC-PI):	-Dimensions: 490 x 330 x 310 mm. approx. -Weight: 30 Kg. approx.

*Specifications subject to change without previous notice, due to the convenience of improvements of the product.



C/ Del Agua, 14. Polígono Industrial San José de Valderas.
28918 LEGANÉS (Madrid). SPAIN.
Phone: 34-91-6199363 FAX: 34-91-6198647
E-mail: edibon@edibon.com WEB site: www.edibon.com

Issue: ED01/09
Date: December/2009

REPRESENTATIVE:

