


**OPEN CONTROL
+
MULTICONTROL
+
REAL TIME CONTROL**



www.edibon.com

- Products
- Products range
- Units
- 7.-Mechanics & Materials & 9.-Thermodynamics & Thermotechnics

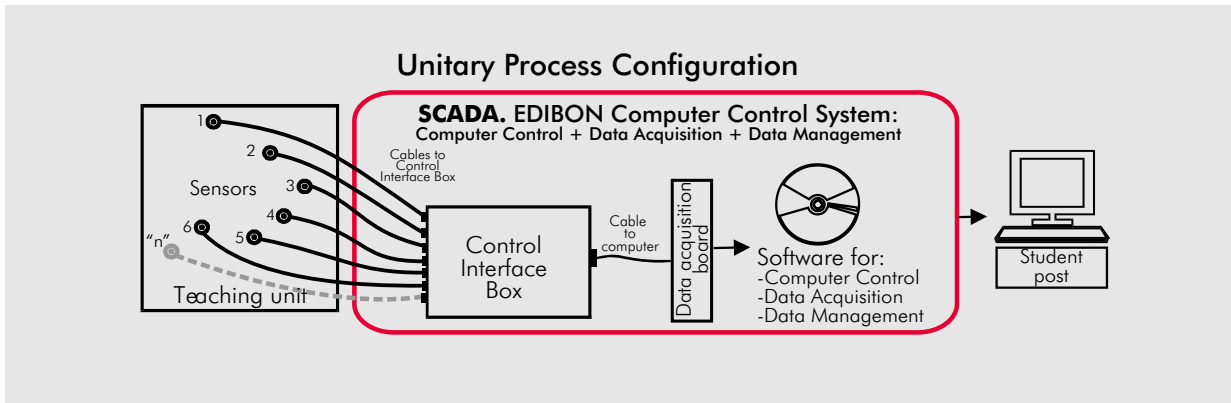

ISO:9001-2000 Certificate of Approval. Reg. No. E204034



European Union Certificate



Certificates ISO 14001: 2004 and ECO-Management and Audit Scheme (environmental management)



Worlddidac Quality Charter Certificate Worlddidac Member

Items supplied as standard

① TEVC. Unit:

Scaled ventilation training unit enables students to study basic airflow and fluid mechanics as well as process of commissioning and balancing a multiducted air distribution system.

Metallic structure. Panels and main metallic elements in stainless steel.

Diagram in the front panel with similar distribution that the elements in the real unit.

Variable speed centrifugal fan , computer controlled:

Supply pressure up to 350Nm^{-2} .

Flow rate: $1400\text{ m}^3\text{h}^{-1}$ approx.

Rectangular air intake and filter holder.

The fan discharges into a 200 mm diameter steel duct and this connects to distribution ductwork.

Connections and ductwork are manufactured in steel and may be connected in different forms.

The ductwork is supported from air distribution isolation mounts hung on steel pedestals linked together.

Necessary components are supplied with the unit to enable parallel branch and line balancing experiments to be undertaken.

Air power supply points are provide that may be balanced on the assembled unit to supply a range of airflows.

Pressure sensors.

Flow sensors.

Pilot static tube.

OPTIONAL ACCESSORIES: (not included in the standard supply)

TEVC/B . **Extra ducting kit B.** Extra duct configuration allows the addition of a third parallel branch and two air supply units.

TEVC/C . **Extra ducting kit C.** Extra duct configuration allows the addition of a 6 branch and two air supply units.

TEVC/D. **Ductwork leakage tester.**

② TEVC. Control Interface Box :

Control interface box with process diagram in the front panel and with the same distribution that the different elements located in the unit, for an easy understanding by the student.

All sensors, with their respective signals, are properly manipulated for -10V to $+10\text{V}$ computer output.

Sensors connectors in the interface have different pines numbers (from 2 to 16), to avoid connection errors.

Single cable between the control interface box and computer.

The unit control elements are permanently computer controlled, without necessity of changes or connections during the whole process test procedure.

Simultaneously visualization in the computer of all parameters involved in the process.

Calibration of all sensors involved in the process.

Real time curves representation about system responses.

Storage of all the process data and results in a file.

Graphic representation, in real time, of all the process/system responses.

All the actuators' values can be changed at any time from the keyboard allowing the analysis about curves and responses of the whole process.

All the actuators and sensors values and their responses are placed in only one computer screen.

Shield and filtered signals to avoid external interferences.

Real time control with flexibility of modifications from the computer keyboard of the parameters, at any moment during the process.

Real time control and on/off control for pumps, compressors, resistances, control valves, etc.

Open control allowing modifications, at any time and in a real time , of parameters involved in the process simultaneously.

Three safety levels, one mechanical in the unit, other electronic in control interface and the third one in the control software.

③ DAB. Data Acquisition Board:

PCI Data acquisition board (National Instruments) to be placed in a computer slot. Bus PCI.

Analog input:

Number of channels= 16 single-ended or 8 differential.

Resolution= 16 bits, 1 in 65536.

Sampling rate up to: 250 KS/s (Kilo samples per second).

Input range (V) = $\pm 10\text{V}$.

Data transfers=DMA, interrupts, programmed I/O.

Number of DMA channels=6.

Analog output:

Number of channels=2.

Resolution= 16 bits, 1 in 65536.

Maximum output rate up to: 833 KS/s.

Output range(V) = $\pm 10\text{V}$.

Data transfers=DMA, interrupts, programmed I/O.

Digital Input/Output:

Number of channels=24 inputs/outputs.

DO or DI Sample Clock frequency: 0 to 1 MHz.

Timing:

Counter/timers=2. Resolution: Counter/timers: 32 bits.

④ TEVC /CCSOF. Computer Control + Data Acquisition + Data Management Software:

Compatible with actual Windows operating systems. Graphic and intuitive simulation of the process in screen.

Compatible with the industry standards.

Registration and visualization of all process variables in an automatic and simultaneously way.

Flexible, open and multicontrol software, developed with actual windows graphic systems, acting simultaneously on all process parameters.

Management, processing, comparison and storage of data.

Sampling velocity up to 250,000 data per second guaranteed.

Student calibration system for all sensors involved in the process.

It allows the registration of the alarms state and the graphic representation in real time.

Comparative analysis of the obtained data, after to the process and modification of the conditions during the process.

Open software, allowing to the teacher to modify texts, instructions. Teacher's and student's passwords to facilitate the teacher's control on the student, and allowing the access at different work levels.

This unit allows that the 30 students of the classroom can visualize simultaneously all results and manipulation of the unit, during the process, by using a projector.

⑤ Cables and Accessories.

⑥ Manuals:

This unit is **supplied with 8 manuals:** Required Services, Assembly and Installation, Interface and Control Software, Starting-up, Safety, Maintenance, Calibration & Practices Manuals.

***References 1 to 6: TEVC + TEVC /CIB + DAB + TEVC /CCSOF + Cables and Accessories + Manuals are included in the minimum supply, enabling a normal operation.**

Continue...

Complementary items to the standard supply

PLC. Industrial Control using PLC (7 and 8):

⑦ PLC-PI. PLC Module:

Circuit diagram in the front panel.

Front panel:

Digital inputs(X) and Digital outputs (Y) block:

16 Digital inputs, activated by switches and 16 LEDs for confirmation (red).

14 Digital outputs (through SCSI connector) with 14 LEDs for message (green).

Analog inputs block:

16 Analog inputs (-10V. to + 10V.)(through SCSI connector).

Analog outputs block:

4 Analog outputs (-10V. to + 10V.)(through SCSI connector).

Touch screen:

High visibility and multiple functions.

Display of a highly visible status.

Recipe function.

Bar graph function.

Flow display function.

Alarm list.

Multi language function.

True type fonts.

Back panel:

Power supply connector.

Fuse 2A.

RS-232 connector to PC.

Inside:

Power supply outputs: 24 Vdc, 12 Vdc, -12 Vdc, 12 Vdc variable.

Panasonic PLC:

High-speed scan of 0.32 μsec. for a basic instruction.

Program capacity of 32 Ksteps, with a sufficient comment area.

Free input AC voltage(100 to 240 VAC).

DC input: 16 (24 VDC).

Relay output: 14 (250 VA AC/2 A).

High-speed counter.

Multi-point PID control.

Digital inputs/outputs and analog inputs/outputs Panasonic modules.

Communication RS232 wire, to computer (PC).

⑧ TEVC/PLC-SOF. PLC Control Software:

For this particular unit, always included with PLC supply.



PLC-PI

Items available on request

⑨ TEVC/CAL. Computer Aided Learning Software (Results Calculation and Analysis).

⑩ TEVC/FSS. Faults Simulation System.

EXERCISES AND PRACTICAL POSSIBILITIES

Some Practical Possibilities of the Unit:


- 1.- Examination of typical components, fabrication, installation and assembly techniques used in air handling systems.
- 2.- Investigation of pressure losses in beds, branches, changes of section and over straight lengths of duct, together with the variation in pressure drop with velocity.
- 3.- Measurement of air flow rate using pitot-static traverse, orifice pressure differential and anemometer methods.
- 4.- Examination of standard types of panel and bag filters and their pressure drop against face velocity.
- 5.- Determination of the "k" factor for the pressure loss of the above components in each particular configuration.
- 6.- Investigation of the fan pressure and volume flow characteristics at various supply voltages.
- 7.- Balancing of air flow distribution in a series or two branch parallel distribution system using either main damper or fan speed flow control.
- 8.- Allows an additional parallel branch and two diffusers to be investigated.
- 9.- Addition of the ductwork leakage test set allows students to carry out commissioning leak testing on the above components.
- 10.- Allows an additional tee branch and two diffusers to be investigated.
- 11.- Sensors calibration.

Practices to be done by PLC Module (PLC-PI) + PLC Control Software:

- 12.- Control of the TEVC unit process through the control interface box without the computer.

- 13.- Visualization of all the sensors values used in the TEVC unit process.
- 14.- Calibration of all sensors included in the TEVC unit process.
- 15.- Hand on of all the actuators involved in the TEVC unit process.
- 16.- Realization of different experiments, in automatic way, without having in front the unit. (This experiment can be decided previously).
- 17.- Simulation of outside actions, in the cases do not exist hardware elements. (Example: test of complementary tanks, complementary industrial environment to the process to be studied, etc).
- 18.- PLC hardware general use and manipulation.
- 19.- PLC process application for TEVC unit.
- 20.- PLC structure.
- 21.- PLC inputs and outputs configuration.
- 22.- PLC configuration possibilities.
- 23.- PLC program languages.
- 24.- PLC different programming standard languages (literal structured, graphic, etc.).
- 25.- New configuration and development of new process.
- 26.- Hand on an established process.
- 27.- To visualize and see the results and to make comparisons with the TEVC unit process.
- 28.- Possibility of creating new process in relation with the TEVC unit.
- 29.- PLC Programming Exercises.
- 30.- Own PLC applications in accordance with teacher and student requirements.

POSSIBILITIES OF OTHER AVAILABLE EXPANSIONS

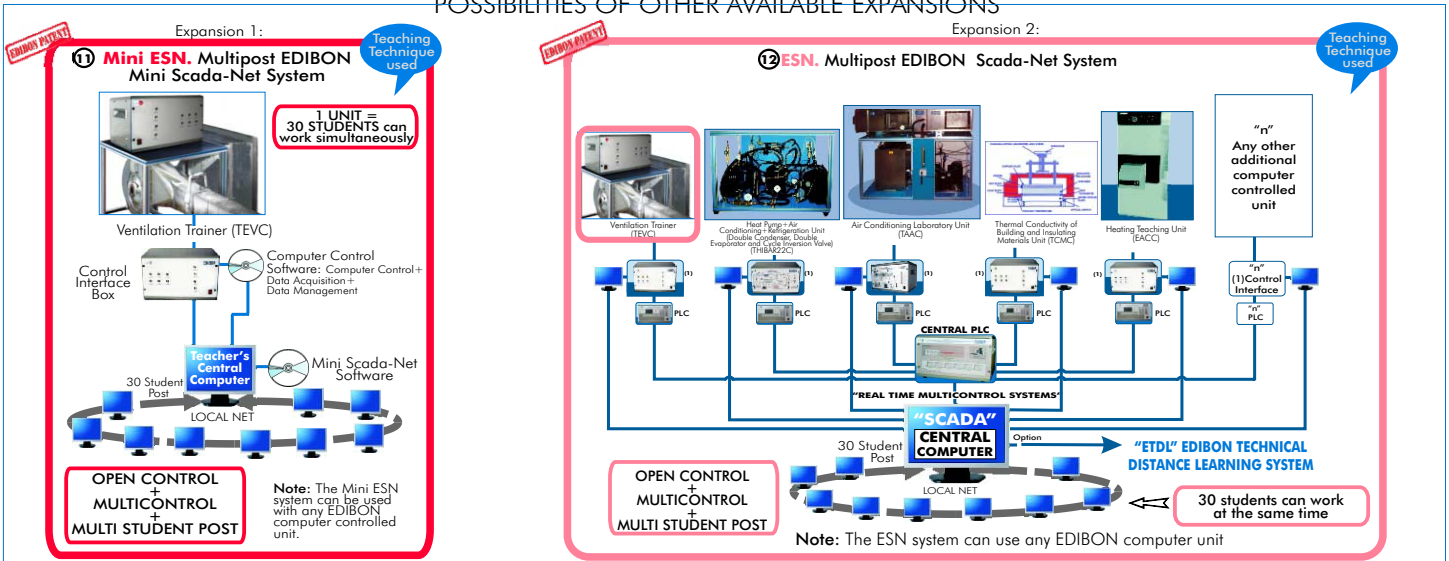

ORDER INFORMATION

Items supplied as standard

Minimum configuration for normal operation includes:

- ① Unit: TEVC. Ventilation Trainer
- ② TEVC /CIB. Control Interface Box.
- ③ DAB. Data Acquisition Board.
- ④ TEVC /CCSOF. Computer Control + Data Acquisition + Data Management Software.
- ⑤ Cables and Accessories.
- ⑥ Manuals.

* **IMPORTANT:** Under TEVC we always supply all the elements for Immediate running as 1, 2, 3, 4, 5 and 6.

Complementary items to the standard supply

- PLC. Industrial Control using PLC (7 and 8):
- ⑦ PCL-PI. PLC Module.
 - ⑧ TEVC /PLC-SOF. PLC Control Software.
 - ⑨ TEVC /CAL. Computer Aided Learning Software (Results Calculation and Analysis). (Available on request).
 - ⑩ TEVC /FSS. Faults Simulation System. (Available on request).
- Expansions
- ⑪ Mini ESN. Multipost EDIBON Mini Scada-Net System.
 - ⑫ ESN. Multipost EDIBON Scada-Net System.

REQUIRED SERVICES

-Electrical supply: 1.5 KW, single- phase, 220V./50Hz or 110V./ 60Hz.

DIMENSIONS & WEIGHTS

TEVC Unit: -Dimensions: 10000x3000x2000 mm. approx.
-Weight :300 Kg. approx.

Control Interface Box: -Dimensions: 490x330x310 mm. approx.
-Weight: 10 Kg. approx.

PLC Module (PLC-PI): -Dimensions: 490x330x310 mm. approx.
-Weight: 30 Kg. approx.

OPTIONAL ACCESSORIES

TEVC/B. Extra ducting kit B.
TEVC/C. Extra ducting kit C.

TEVC/D. Ductwork leakage tester .

*Specifications subject to change without previous notice, due to the convenience of improvements of the product.



C/ Del Agua, 14. Polígono San José de Valderas. 28918 LEGANES (Madrid) SPAIN.
Phone: 34-91-6199363 FAX: 34-91-6198647
E-mail: edibon@edibon.com WEB site: www.edibon.com

Issue: ED01/08
Date: May/2008

REPRESENTATIVE: